

Certificate of Analysis

SLU-PP-332 16.80 mg/unit

Report To:

Peptidology

11111 N Scottsdale Rd STE 205

Scottsdale, AZ 85254

480-974-4660


Compound: SLU-PP-332

Amount: 16.80 mg/unit


Laboratory ID: V260721-3 001

Lot Number: 1730

Date Released: 8/27/2026

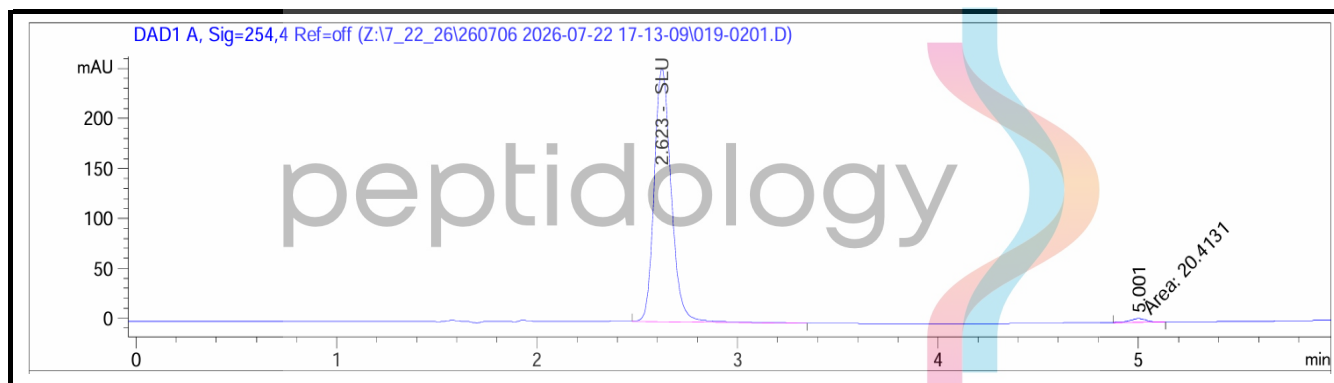

Analysis	Method	Result (per Unit)		
Identity	HPLC-UV/VIS	Pass - Matches Ref. Standard		
Quantity	HPLC-UV/VIS	17.66 mg	16.25 mg	16.48 mg

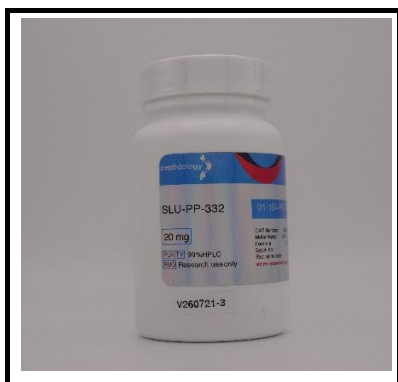


Report By: Dustin Newman, Laboratory Director on 8/27/2026



Approved By: Tori Johnson, Operations Manager on 8/27/2026

Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.



Vanguard Laboratory
2635 Parkmont Ln
Olympia, Wa 98502
360-967-7010

Certificate of Analysis

SLU-PP-332 16.80 mg/unit

Report To:

Peptidology

11111 N Scottsdale Rd STE 205
Scottsdale, AZ 85254
480-974-4660

Compound: SLU-PP-332

Amount: 16.80 mg/unit

Laboratory ID: V260721-3 001

Lot Number: 1730

Date Released: 8/27/2026

Analyte	Method	LOQ (ppm)	Result (ppm)
Chromium (Cr)	ICP-MS	0.05	ND
Arsenic (As)	ICP-MS	0.01	ND
Cadmium (Cd)	ICP-MS	0.01	ND
Lead (Pb)	ICP-MS	0.02	0.02
Mercury (Hg)	ICP-MS	0.005	ND

Run ID: 260810

Analysis	Vial ID	Total Aerobic Count (CFU/mL)	Total Yeast and Mold (CFU/mL)	Pass/Fail
Bioburden (USP <61>)	001	<10	<10	Pass

Report By: Dustin Newman, Laboratory Director on 8/27/2026

Approved By: Tori Johnson, Operations Manager on 8/27/2026

ND: Non-Detect

LOD: Limit of Quantification



Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch. Report was revised on 8/27/2026 with the metals data run ID 260810.